




**December 3-5, 2021  
Orlando, FL**

NOTE: Fire Marshal requires a 5-ft clear aisle every 100-ft.  
version: v11-21

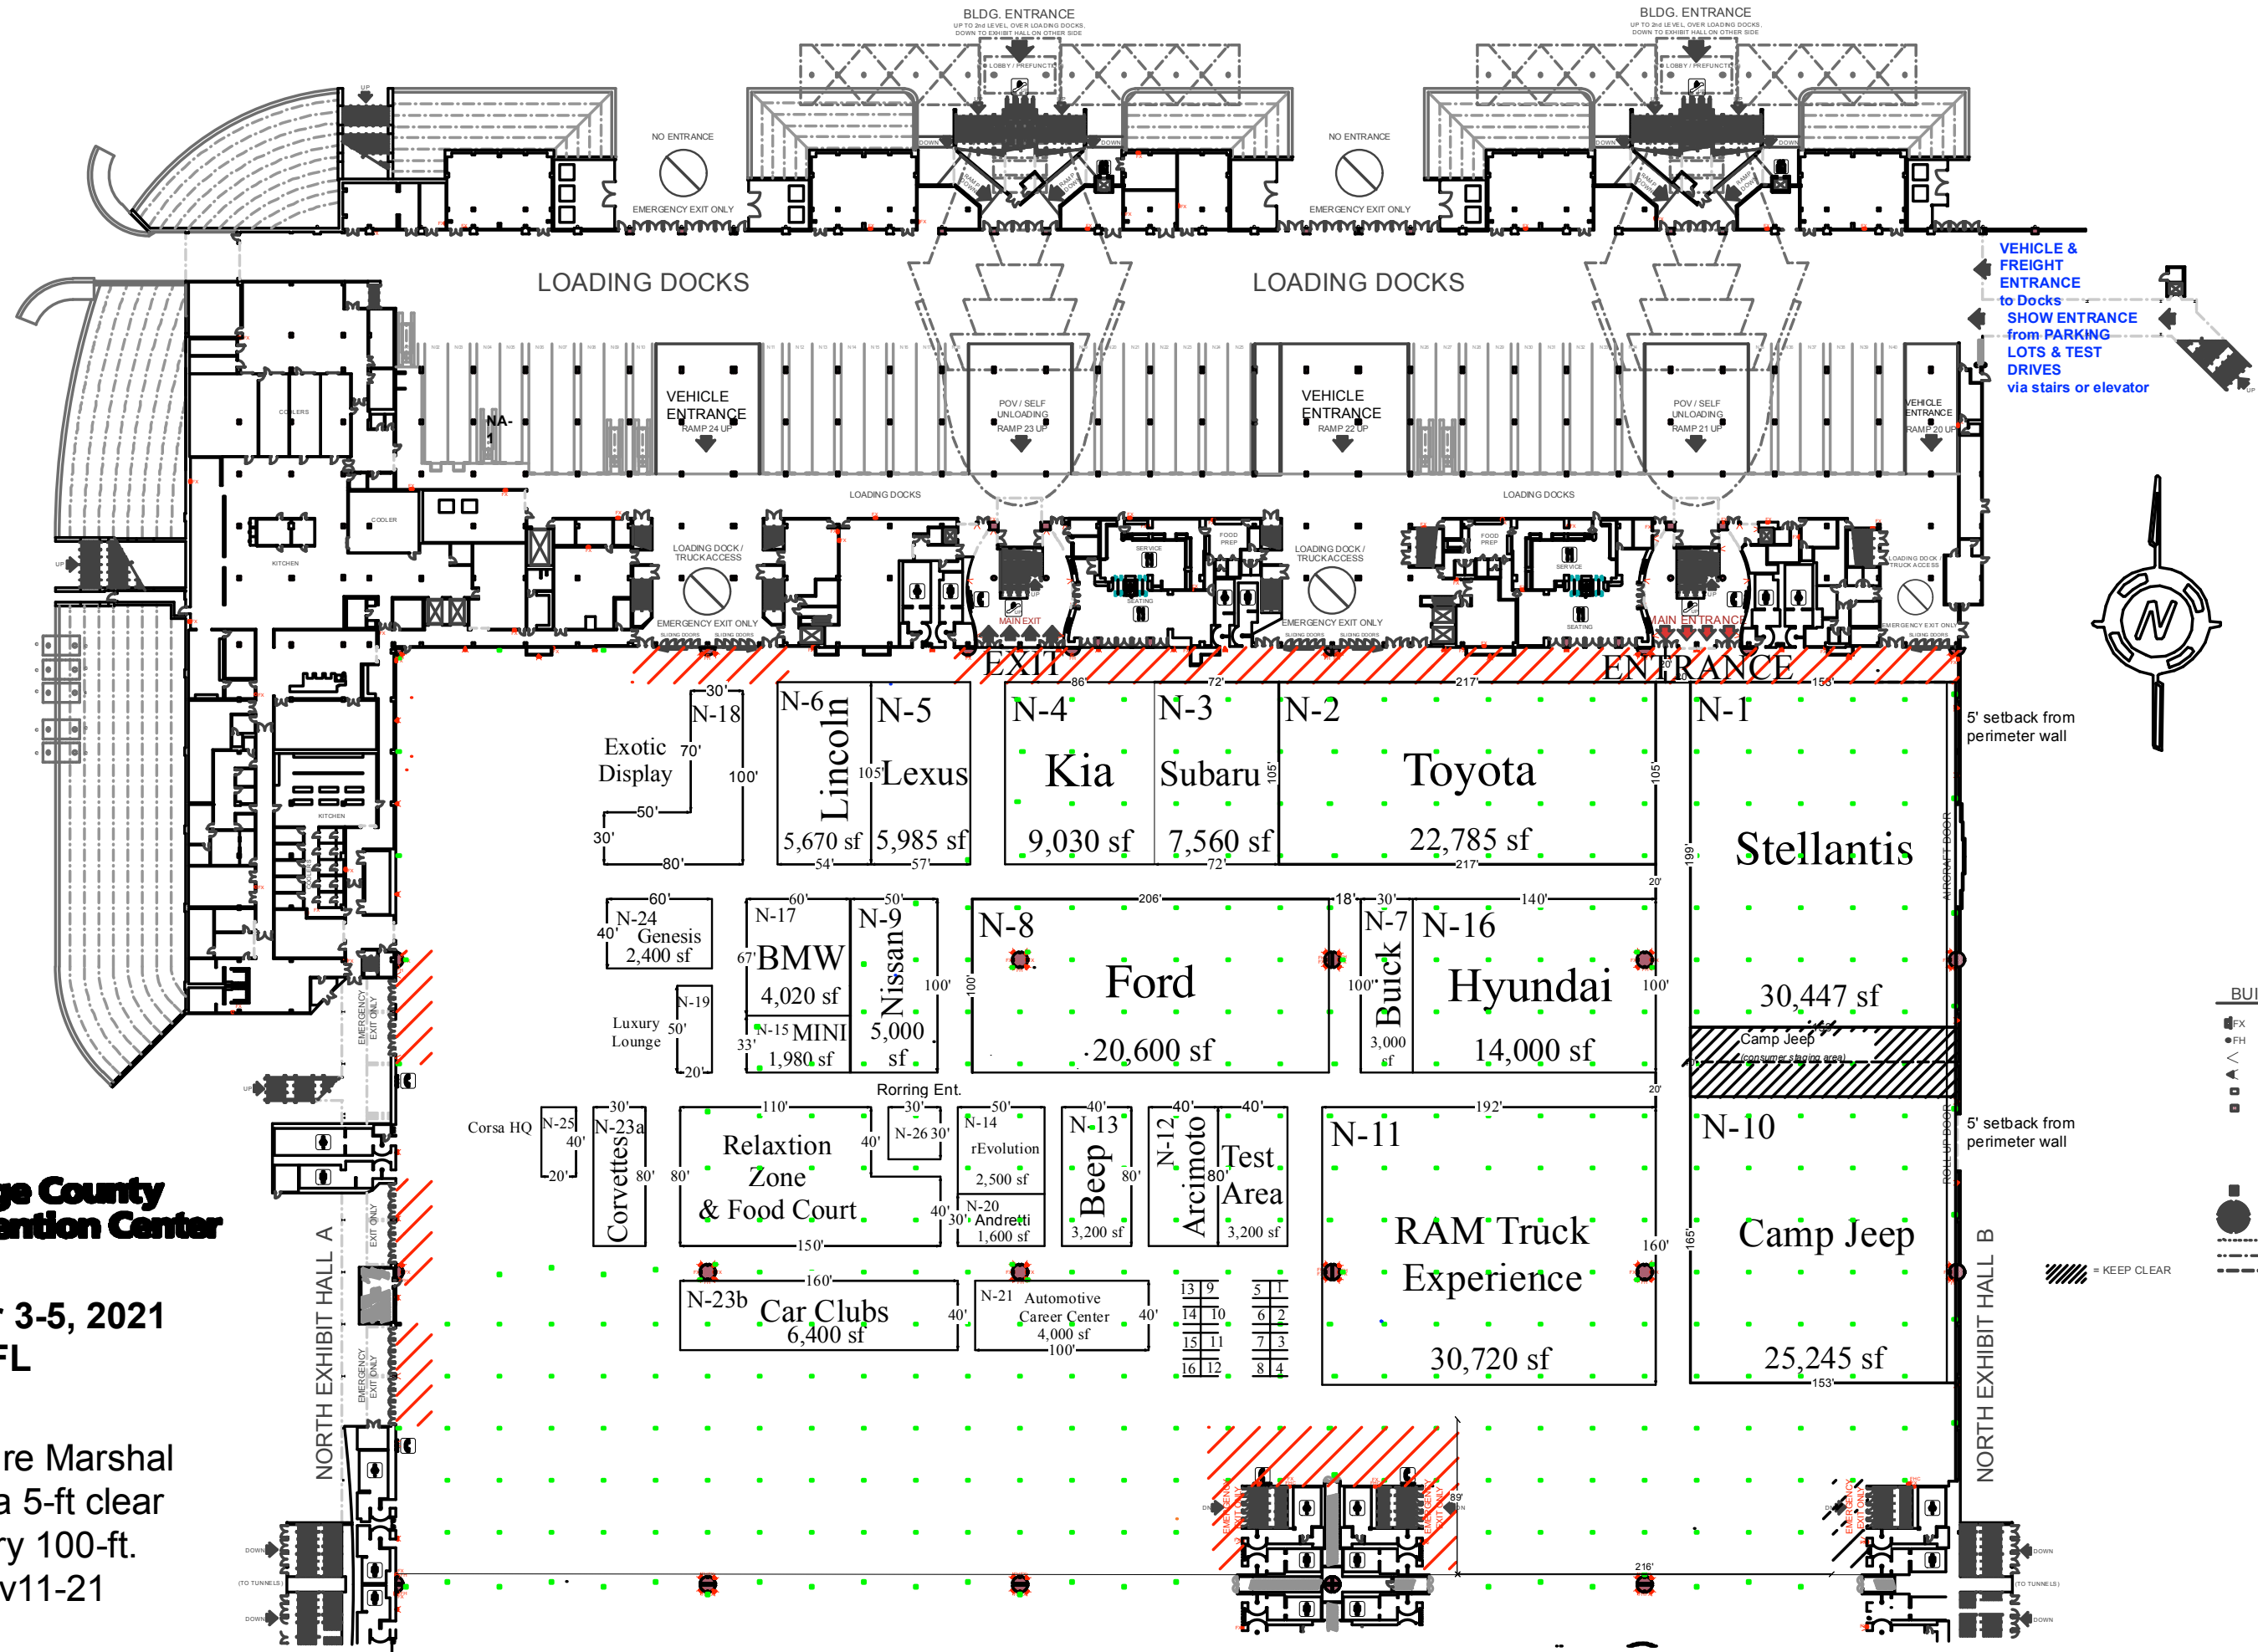

NORTH EXHIBIT HALL A

NORTH EXHIBIT HALL B